



Acron International Technology Limited

Your Technical Companion

HKUST Entrepreneur

Air Cleaner Test Report

Applicant : RHT Industries Limited

Address : Block B, 2/F, Goodwill Industrial Building, No. 36-44 Pak Tin Par
Street, Tsuen Wan, New Territories, Hong Kong

Application Number : KJ2003001-02

Report Number : REPAP20040101

Report Issue Date : 07 Apr 2020

Total Page : 8 Pages (including this page)

This document is issued by the Company under its General Conditions of Service printed overleaf. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any reader of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law.

Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only. This document cannot be reproduced except in full, without prior approval of the Company.

Acron International Technology Limited

IAQ Contractor, IAQ Control Facilities Supplier, IAQ Consultant


Subsidiary company of the Hong Kong University of Science and Technology

Under the Entrepreneurship Program

2. Detail Description of the sample



b-MOLA/ RH-220

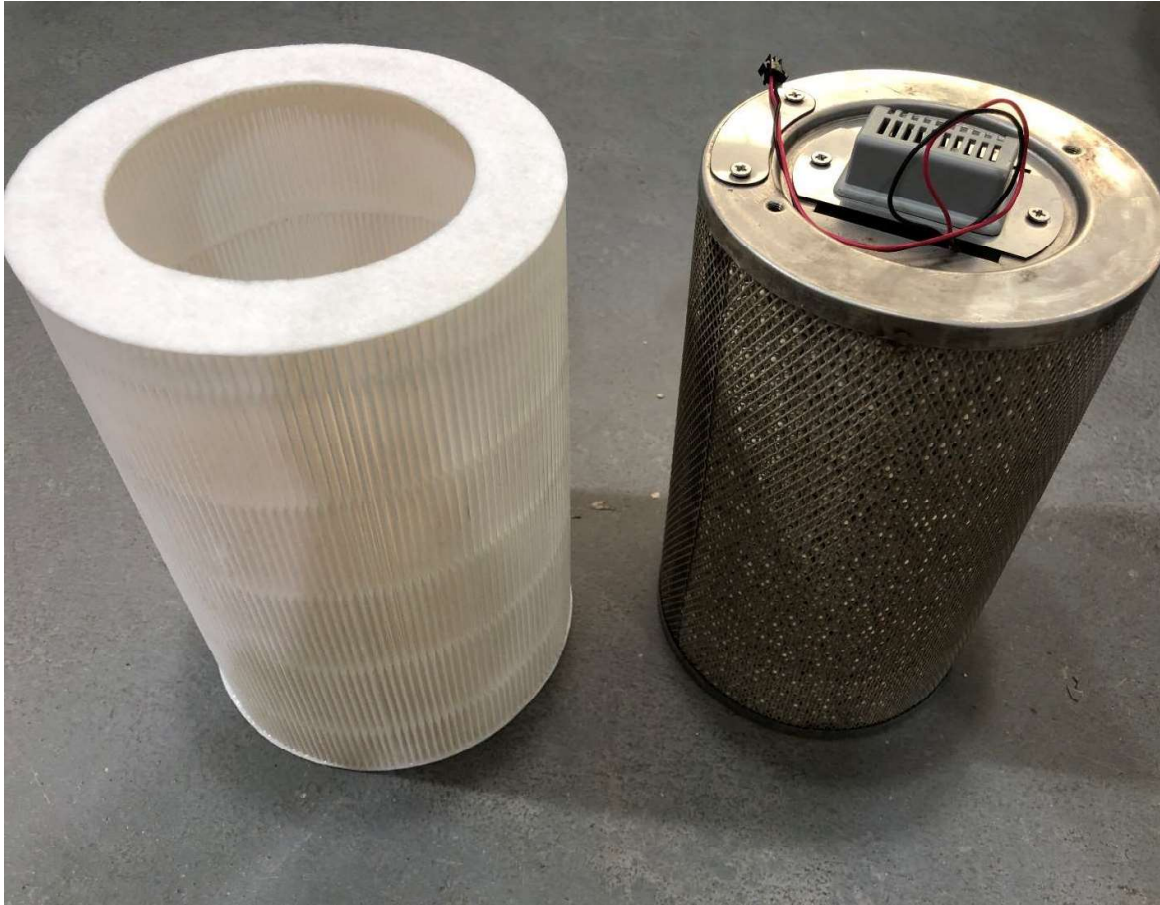

NCCO Reactor (NA213020300) and Normal White HEPA

4. Results of Removal Efficiency

Testing Bacteria	Brand/ Model No.	Item	Airborne Bacteria (CFU/m ²)	Removal Efficiency (%)
Airborne Bacteria	Blank	BLK	N/D (CFU/plate)	-
	Background	BG	1.96×10^1	-
	RHT/ RH-220 (AOG Off)	O	5.59×10^3	-
	RHT/ RH-220 (AOG On)	N	8.82×10^2	84.15